


KN1643FC20

HORIZONTALLY MOUNTED EMERGENCY SHOWER WITH STAY-OPEN BALL VALVE AND PULL ROD

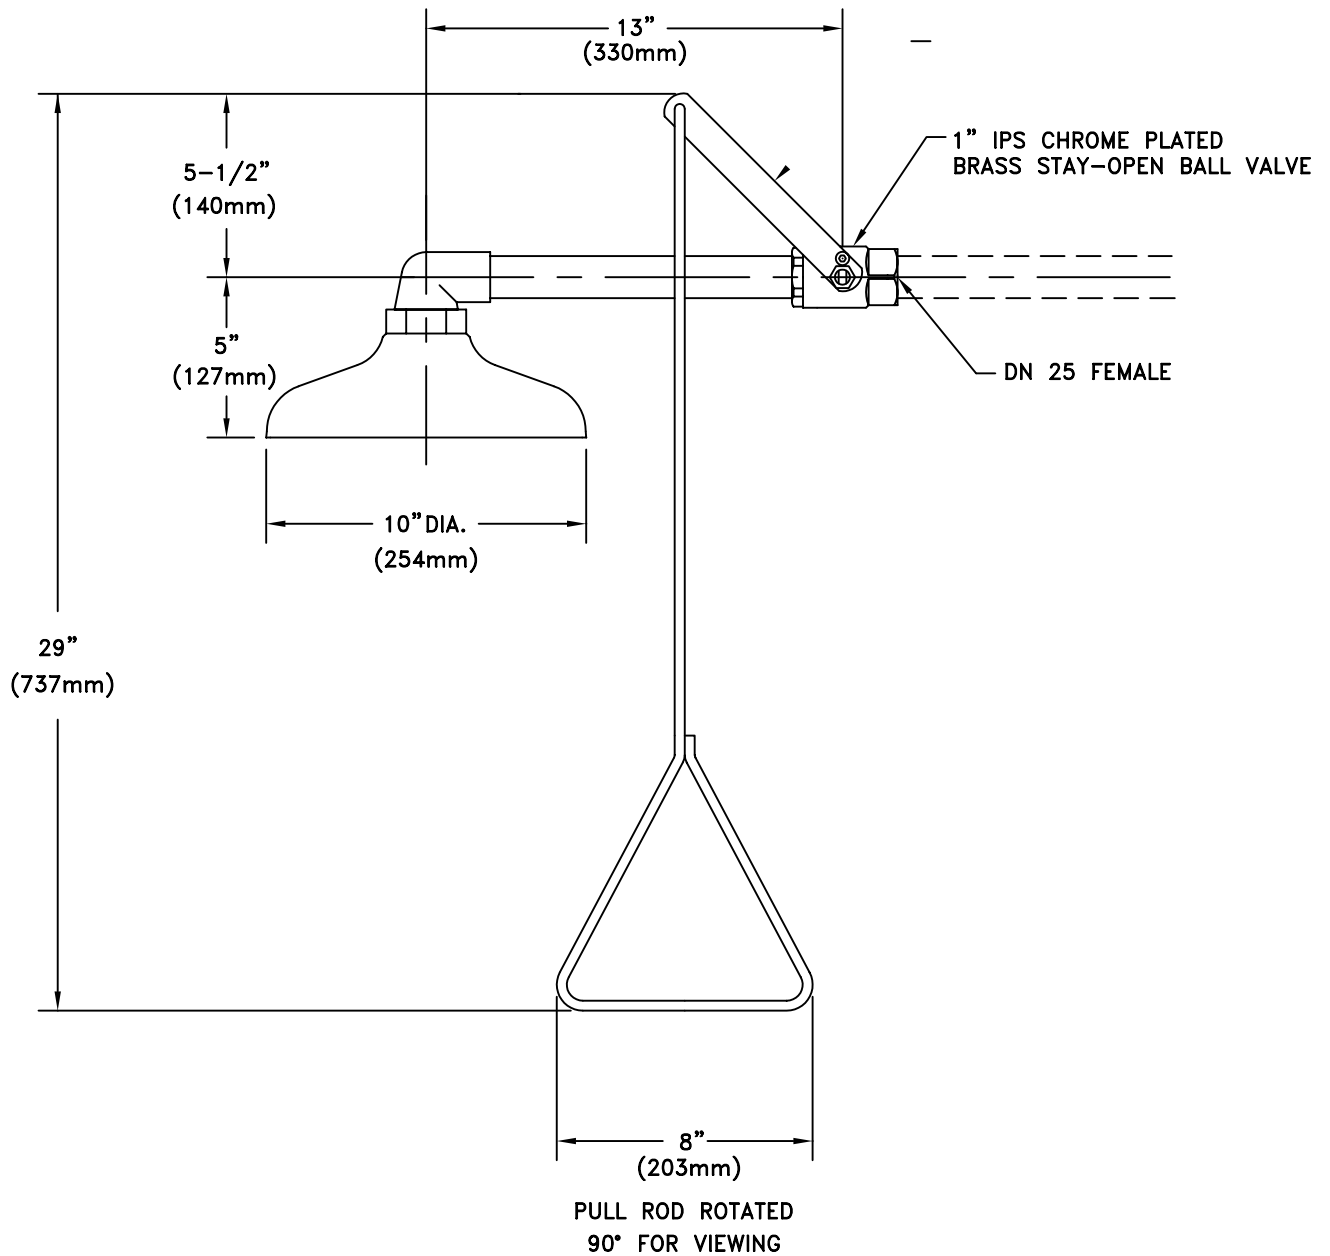

UNITS (EXCEPT THOSE WITH SELF-CLOSING VALVES) COMPLY WITH THE REQUIREMENTS OF ANSI Z358.1. TEST ALL EMERGENCY EQUIPMENT AT LEAST WEEKLY.

Drawing Number: K001-431

Approved: _____

Revision Number: 082404-TPS