


KN1643FC20

HORIZONTALLY MOUNTED EMERGENCY SHOWER WITH STAY-OPEN BALL VALVE AND PULL ROD

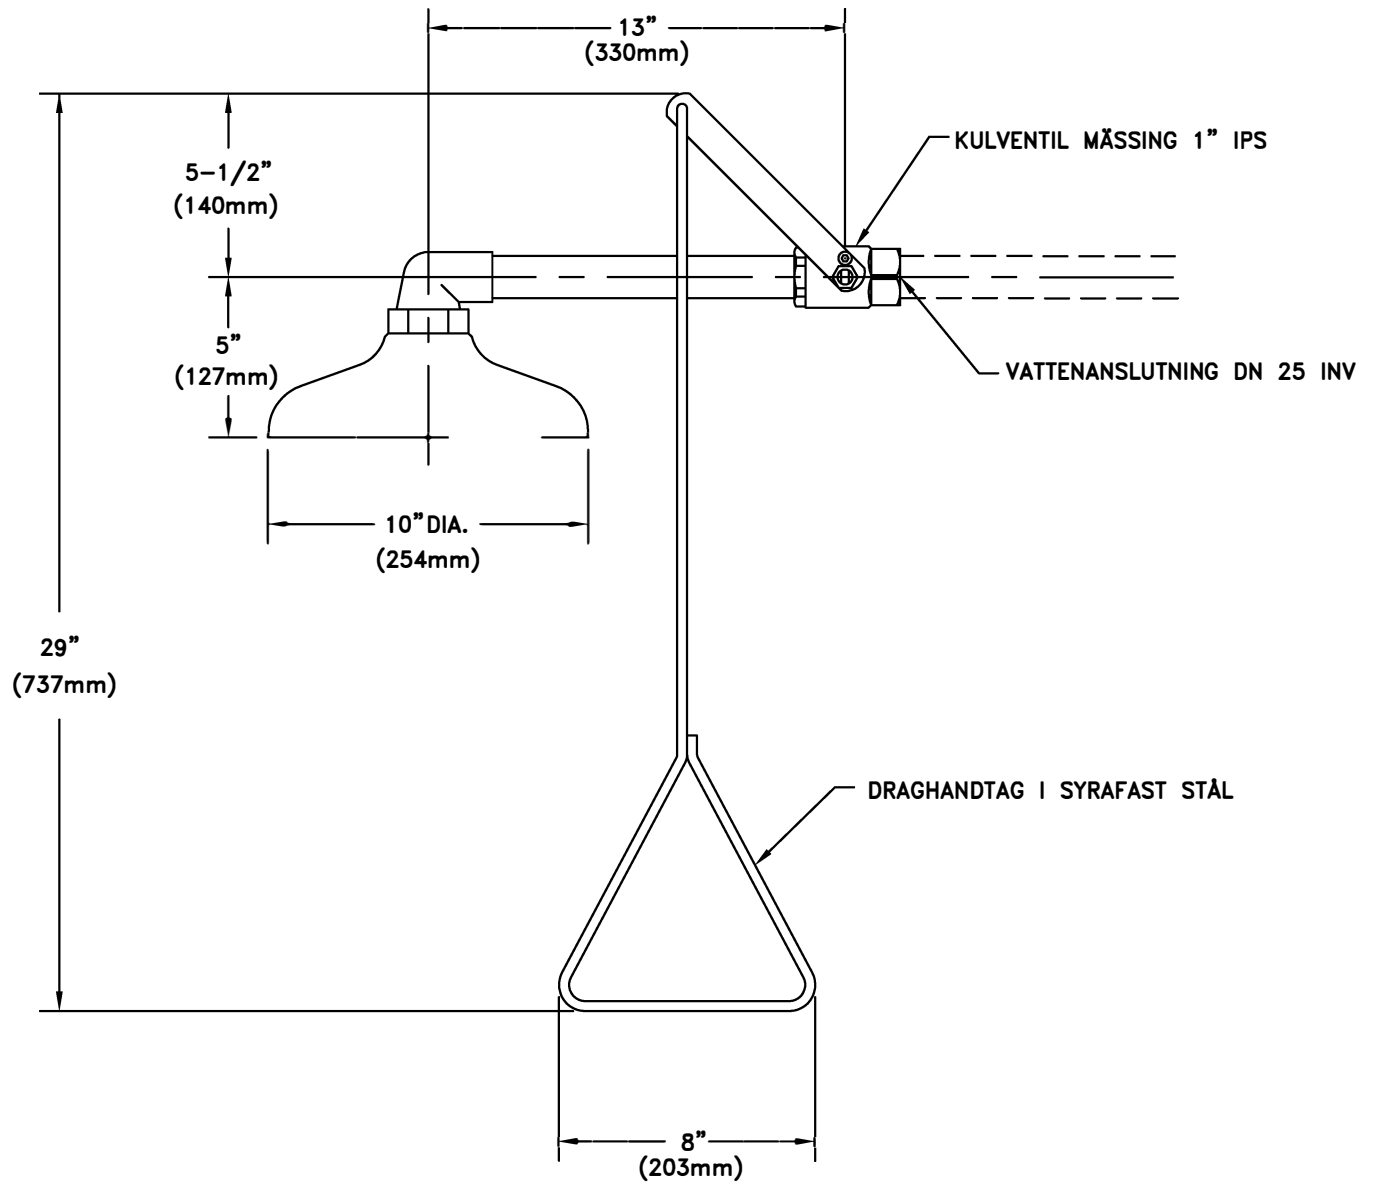

Revision Notice:

*This drawing is not the latest version for the product.
Minor component modifications are forthcoming,
but user impact will be negligible.
Updated drawings expected in November 2023.*

UNITS (EXCEPT THOSE WITH SELF-CLOSING VALVES) COMPLY WITH THE REQUIREMENTS OF ANSI Z358.1.

TEST ALL EMERGENCY EQUIPMENT AT LEAST WEEKLY.

Drawing Number: **K001-431**

Approved: _____

Revision Number: **082404-TPS**